



AUTEXIER

MANUFACTURER OF INDUSTRIAL VALVES

93 Rue Louis Blanc - 02300 CHAUNY - FRANCE
 Phone : +33 (0)3 23 52 02 86 Fax : +33 (0)3 23 39 52 28
 Website : www.autexier.fr

Ref. A76 Family : 49

Rev. 02

Date : 11 Feb. 2025

Page 1/1

BRONZE 3 WAY BALL VALVE WITH FLANGES

Ref. A76T65

SERIES :

- A76
- Three-way T

For material compatibility, contact us

CARACTERISTICS :

- PN30 (Nominal Pressure)
- ENDS : ISO PN16 Flanges
- MATERIAL : BRONZE CC491K

MAXIMUM CONDITIONS OF USE :

- 30 bar of -15°C to 200°C





APPLICATIONS :

- Water-based fluids
- Oil & gas

OPTIONS :

- Special drilling
- Lockable handle
- Monel stem and ball
- Fourth way

Specific dimensions, contact us

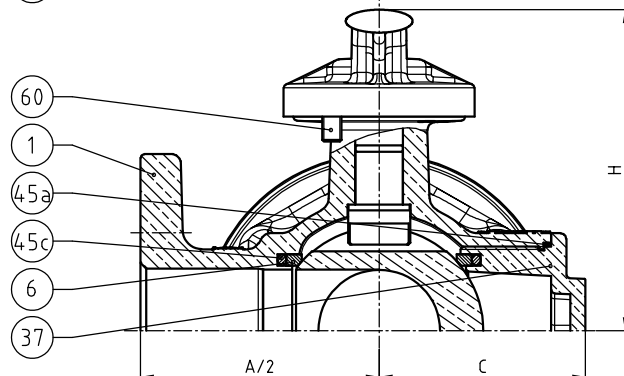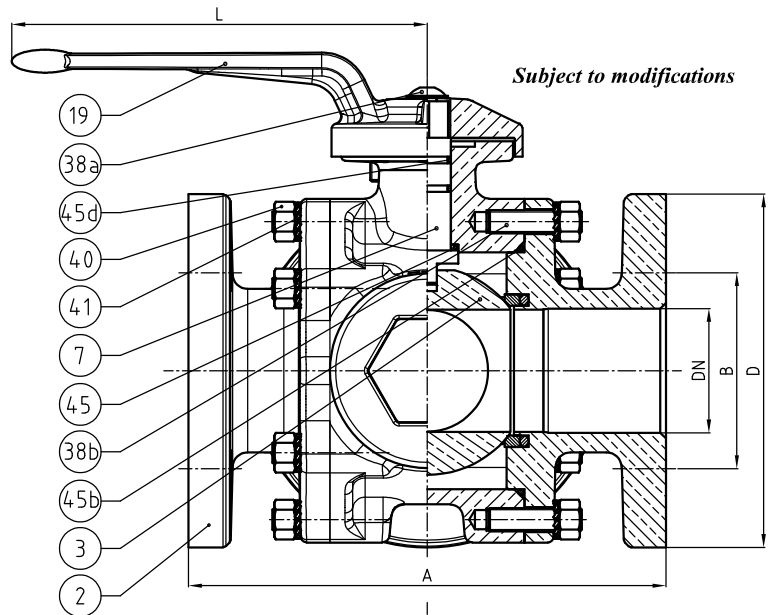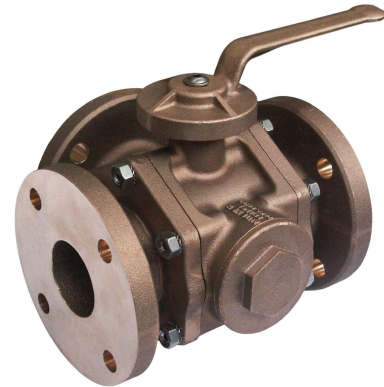

| DIMENSIONS | |
|----------------------|--------|
| DN | 65 |
| A (mm) | 250 |
| B (mm) | 145 |
| C (mm) | 108 |
| D (mm) | 185 |
| H (mm) | 168 |
| L (mm) | 218 |
| Base ISO | F07 |
| S (mm) | 17 |
| Maximum torque (N.m) | 40* |
| Weight (Kg) | 34,430 |

*Under reserve

NOMENCLATURE

| Rep | Qty | Designation | Material |
|-----|-----|-----------------|------------------------|
| 1 | 1 | BODY | BRONZE |
| 2 | 2 | COVER | BRONZE |
| 3 | 1 | BALL | ALUMINIUM BRONZE |
| 6 | 2 | SEAT | PTFE |
| 7 | 1 | STEM | ALUMINIUM BRONZE |
| 19 | 1 | HANDLE | BRONZE |
| 37 | 1 | PLUG | BRONZE |
| 38a | 1 | SCREW | STAINLESS STEEL A4-70 |
| 38b | 12 | SCREW | STAINLESS STEEL A4 21H |
| 40 | 12 | NUT | STAINLESS STEEL A4-70 |
| 41 | 12 | WASHER | STAINLESS STEEL A4 |
| 45 | 1 | GASKET | PTFE |
| 45a | 1 | O-RING | FPM |
| 45b | 2 | O-RING | FPM |
| 45c | 4 | O-RING | FPM |
| 45d | 2 | O-RING | FPM |
| 60 | 1 | SPRING PLUNGERS | STAINLESS STEEL A1 |

REFERENCES NORMS :

- Material : NF EN 1982 - NF EN 12163 - NF EN 12164 - NF EN 10272
- Testing & checking : NF EN 12266-1/-2 (bench test)
- Flanges : NF EN 1092-3

Ref. instruction of assembling : 0904DA157E

Ref. instruction of operation : 0904DA158E

Mounting & assembly guides are available on our website.

These data are for information and can be modified without notice. It is not up to us to appreciate specifications. It is up to the customer to verify the adequacy between the equipment chosen and the real conditions of use.